

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Pavezzi Pty Ltd  
164 Hoddle Street  
Abbotsford VIC 3067

**Test Number :** 22-001050  
**Issue Date :** 11/05/2022  
**Print Date :** 24/05/2022

**Sample Description** Clients Ref : "Pavezzi Riviera Resisto 138/190"  
Composite decking boards  
Colour : Grey  
End Use : Decking  
Nominal Composition : 60% Wood Fibre, 20% HDPE, 15% Talcum Powder, 5% Additives  
Nominal Mass per Unit Area/Density : 1380g/m<sup>2</sup>  
Nominal Thickness : 23mm

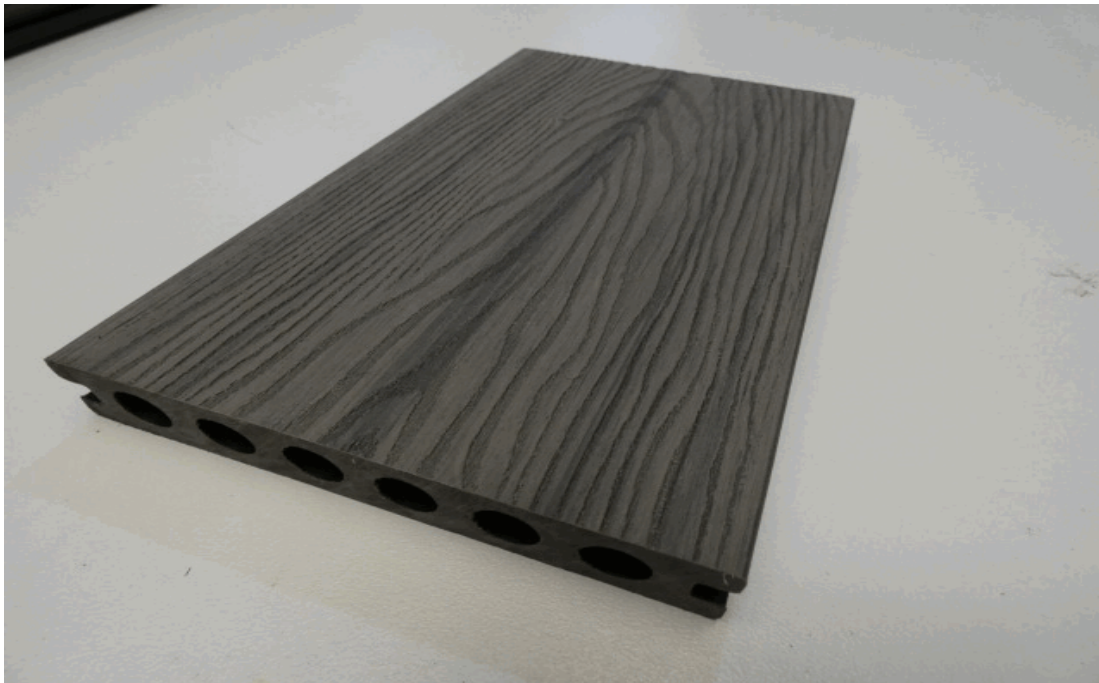

268587

57451

Page 1 of 3

© Australian Wool Testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing  
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

Fiona McDonald  
APPROVED SIGNATORY



MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Pavazzi Pty Ltd  
164 Hoddle Street  
Abbotsford VIC 3067

**Test Number :** 22-001050  
**Issue Date :** 11/05/2022  
**Print Date :** 24/05/2022

### AS ISO 9239.1-2003

### Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a Radiant Heat Source

Date of Sample Arrival 30-03-2022

Date Tested 06-05-2022

CHF Value	1	2	3	Mean
Length	6.0	3.7	4.7	4.8 kW/m <sup>2</sup>
Width	7.1	-	-	- kW/m <sup>2</sup>

HF-30 Value	1	2	3	Mean
Length	-	6.2	4.7	- kW/m <sup>2</sup>
Width	7.1	-	-	- kW/m <sup>2</sup>

Smoke Value	1	2	3	Mean
Length	214	362	587	388 %min
Width	199	-	-	- %min

Observations:

Blistering Yes

268587

57451

Page 2 of 3

© Australian Wool Testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing  
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



Fiona McDonald  
APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Pavazzi Pty Ltd  
164 Hoddle Street  
Abbotsford VIC 3067

**Test Number :** 22-001050  
**Issue Date :** 11/05/2022  
**Print Date :** 24/05/2022

Each specimen was clamped to a substrate of 6mm thick fibre reinforced cement board prior to testing.

HF30 not reported as flame out time occurred before 30 minutes.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of  $23\pm 2^{\circ}\text{C}$  and relative humidity of  $50\pm 5\%$  for a minimum of 48 hours prior to testing.

Results in accordance with section 8.4 have not been included in the report. They are available upon request.

268587

57451

Page 3 of 3

© Australian Wool Testing Authority Ltd  
Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing  
Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.

Fiona McDonald  
APPROVED SIGNATORY



MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR